DO NOT SCALE IF IN DOUBT ASK

CUSTOMER APPROVAL	
Name	
Sign	
Position	
Date	
Control Panel Location	TO BE DETERMINED

CONTROL PANEL
POSITION TO BE DETERMINED
PANEL SIZE 1200x1000x300mm HxWxD
WITH OVER TEMPERATURE PROTECTION
REQUIRING AN ISOLATED AND PROTECTED SUPPLY
TO SUIT A LOAD OF 150A PER PHASE
380/415 3 PHASE + NEUTRAL + EARTH

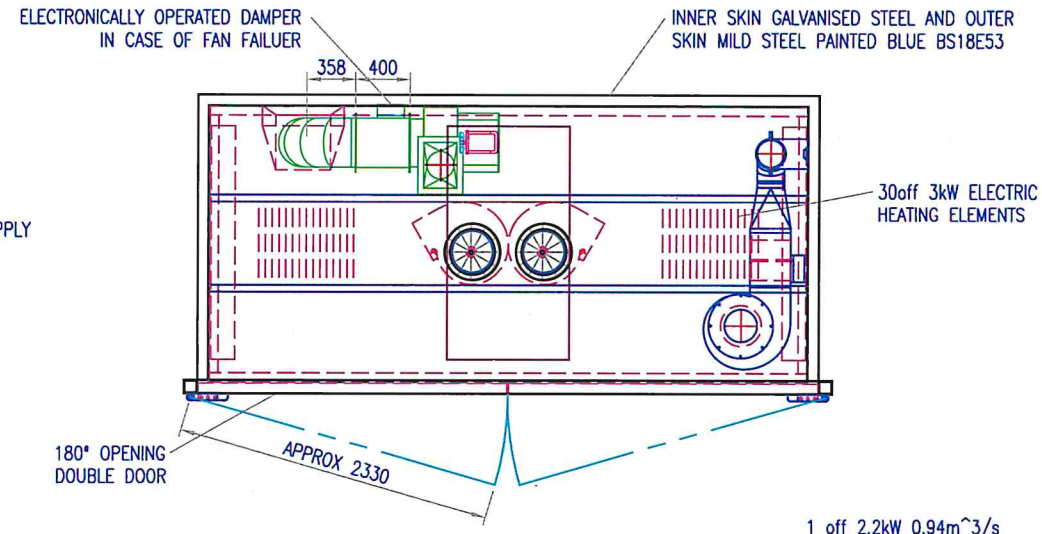

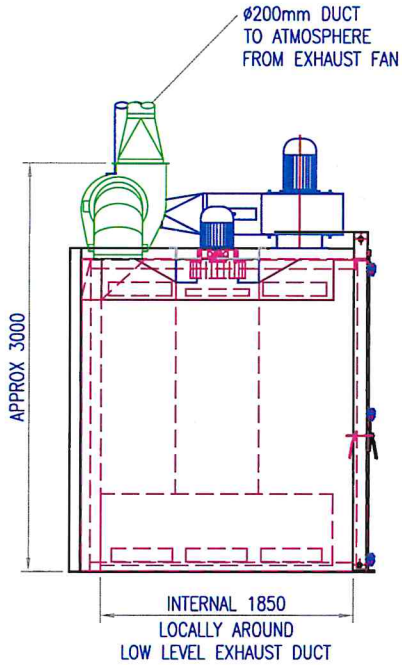

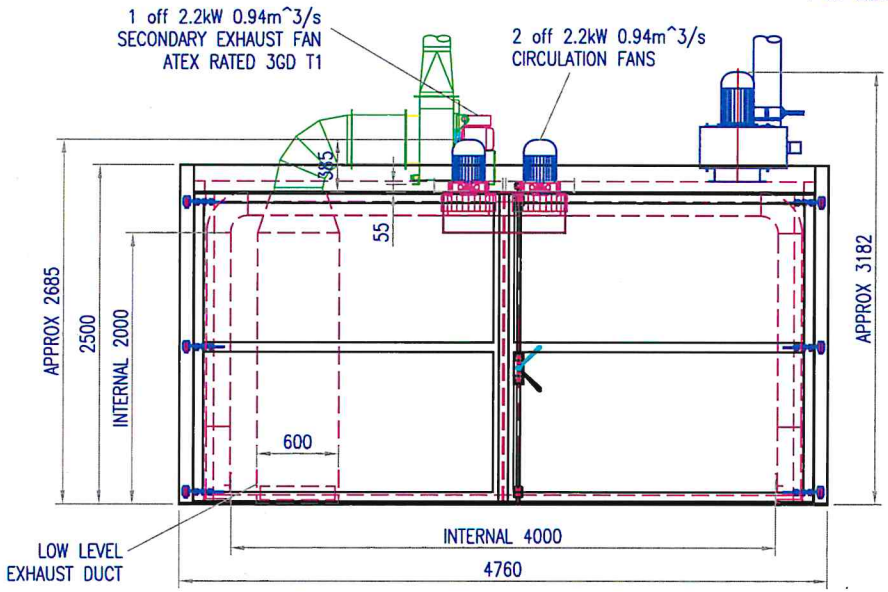

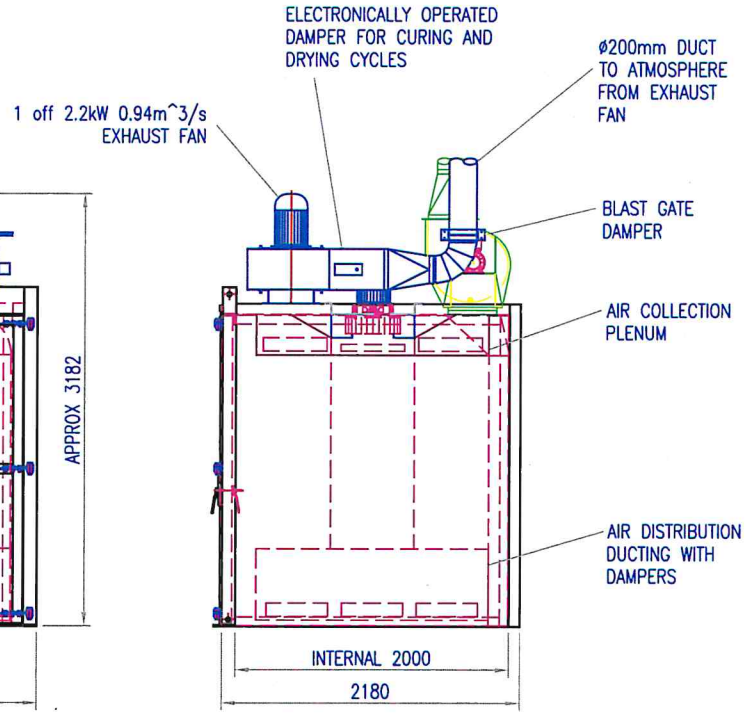

REV	DESCRIPTION	DATE	SIG.
D			
C			
B	SECONDARY EXHAUST FAN MOVED	2015-02-12	JW
A	ISSUED	2015-02-10	JW

REVISIONS

airflow

TITLE: CUSTOMER APPROVAL ADDITIONAL EXHAUST

Drawn By	JW	Scale	NTS
Chck'd By		Date	2015-02-10

DRAWING No: AIR01345/1
REV [A] [B]

CUSTOMER: TRELLEBORG

This drawing must not be used for manufacturing purposes until our acknowledgement is in our hands and unless written permission from AIRFLOW Precision Products Ltd